

Placer County Water Agency

Power System: 24625 Harrison St. • Mail: P.O. Box 667 • Foresthill, California 95631
(530) 367-2291 (530) 885-6917 FAX (530) 367-4440



A Public Agency

BOARD OF DIRECTORS

Pauline Roccucci • Alex Ferreira

Oris Wollan • Lowell Jarvis

Michael R. Lee

David A. Breninger, General Manager

Ed Tiedemann, General Counsel

EAP Revision #4

Revision Date – December 19, 2006

Page 1

December 19, 2006

TO: Placer County Water Agency Emergency Action Plan (EAP) holders

RE: EMERGENCY ACTION PLAN - MIDDLE FORK AMERICAN RIVER PROJECT
Federal Energy Regulatory Commission (FERC), PROJECT NO. 2079

REVISION #4 dated December 19, 2006

Placer County Water Agency (PCWA) is required by FERC to update our EAP for the Middle Fork American River Project as necessary. We have enclosed Revision #4 to our December, 2004 EAP.

The December, 2004 EAP should be located in an area that your personnel can readily locate in a simulated drill scenario or actual emergency.

PCWA is required by FERC to have on file a letter of acknowledgement indicating that you have reviewed the EAP, including the flowcharts and maps, and concur with the actions assigned to your agency. Please carefully review the EAP, including Revision #4. We appreciate any comments or corrections you may have. Please sign and return the enclosed confirmation letter by January 25, 2006, which includes your acknowledgement that the superceded pages of the EAP have been destroyed.

INSTRUCTIONS FOR ADDING REVISION #4 TO THE EAP

- 1) Place a copy of this letter in the front pocket of your EAP binder
- 2) Replace all nine flowcharts in Division I with the new flowcharts


1.3.07 pc: Karen Quinlan, Entriix

Water "Our Most Precious Resource"

EAP Revision #4
Revision Date – December 19, 2006
Page 2

Sincerely,

PLACER COUNTY WATER AGENCY


Stephen J. Jones
Power System Manager

Mal Toy

EAP Revision #4
Revision Date – December 19, 2006
Page 3

CONFIRMATION OF RECEIPT

EAP Copy # 51

January 11, 2007

TO: Greg Young

RE: EMERGENCY ACTION PLAN - MIDDLE FORK AMERICAN RIVER PROJECT
Federal Energy Regulatory Commission (FERC), PROJECT NO. 2079

My signature below acknowledges that Mal Toy (BB)
(Organization Name)

has received PCWA's Revision #4 to the December 2004 Middle Fork American River Project Emergency Action Plan. I acknowledge that the instructions accompanying Revision #4 have been implemented, and that the obsolete pages removed from the EAP have been destroyed by shredding or other suitable methods.

Please make sure your EAP copy number is written on your binder.

We have additional comments regarding the EAP. () Yes

(X) No

If you have comments, please attach them to this letter, or send them to Placer County Water Agency, Attn: Greg Young, PO Box 667, Foresthill, CA, 95631, or e-mail them to gyoung@pcwa.net.

Signature: Bev Bell Beverly Bell

Name (printed): Bev Bell

Title: Administrative Aide


Date: 1.3.07

pc: Entrix 1.3.07 Karen Quidachay

FLOWCHART 1.A.

December 19, 2006

FAILURE or IMMINENT FAILURE OF L.L. ANDERSON DAM (FRENCH MEADOWS DAM)

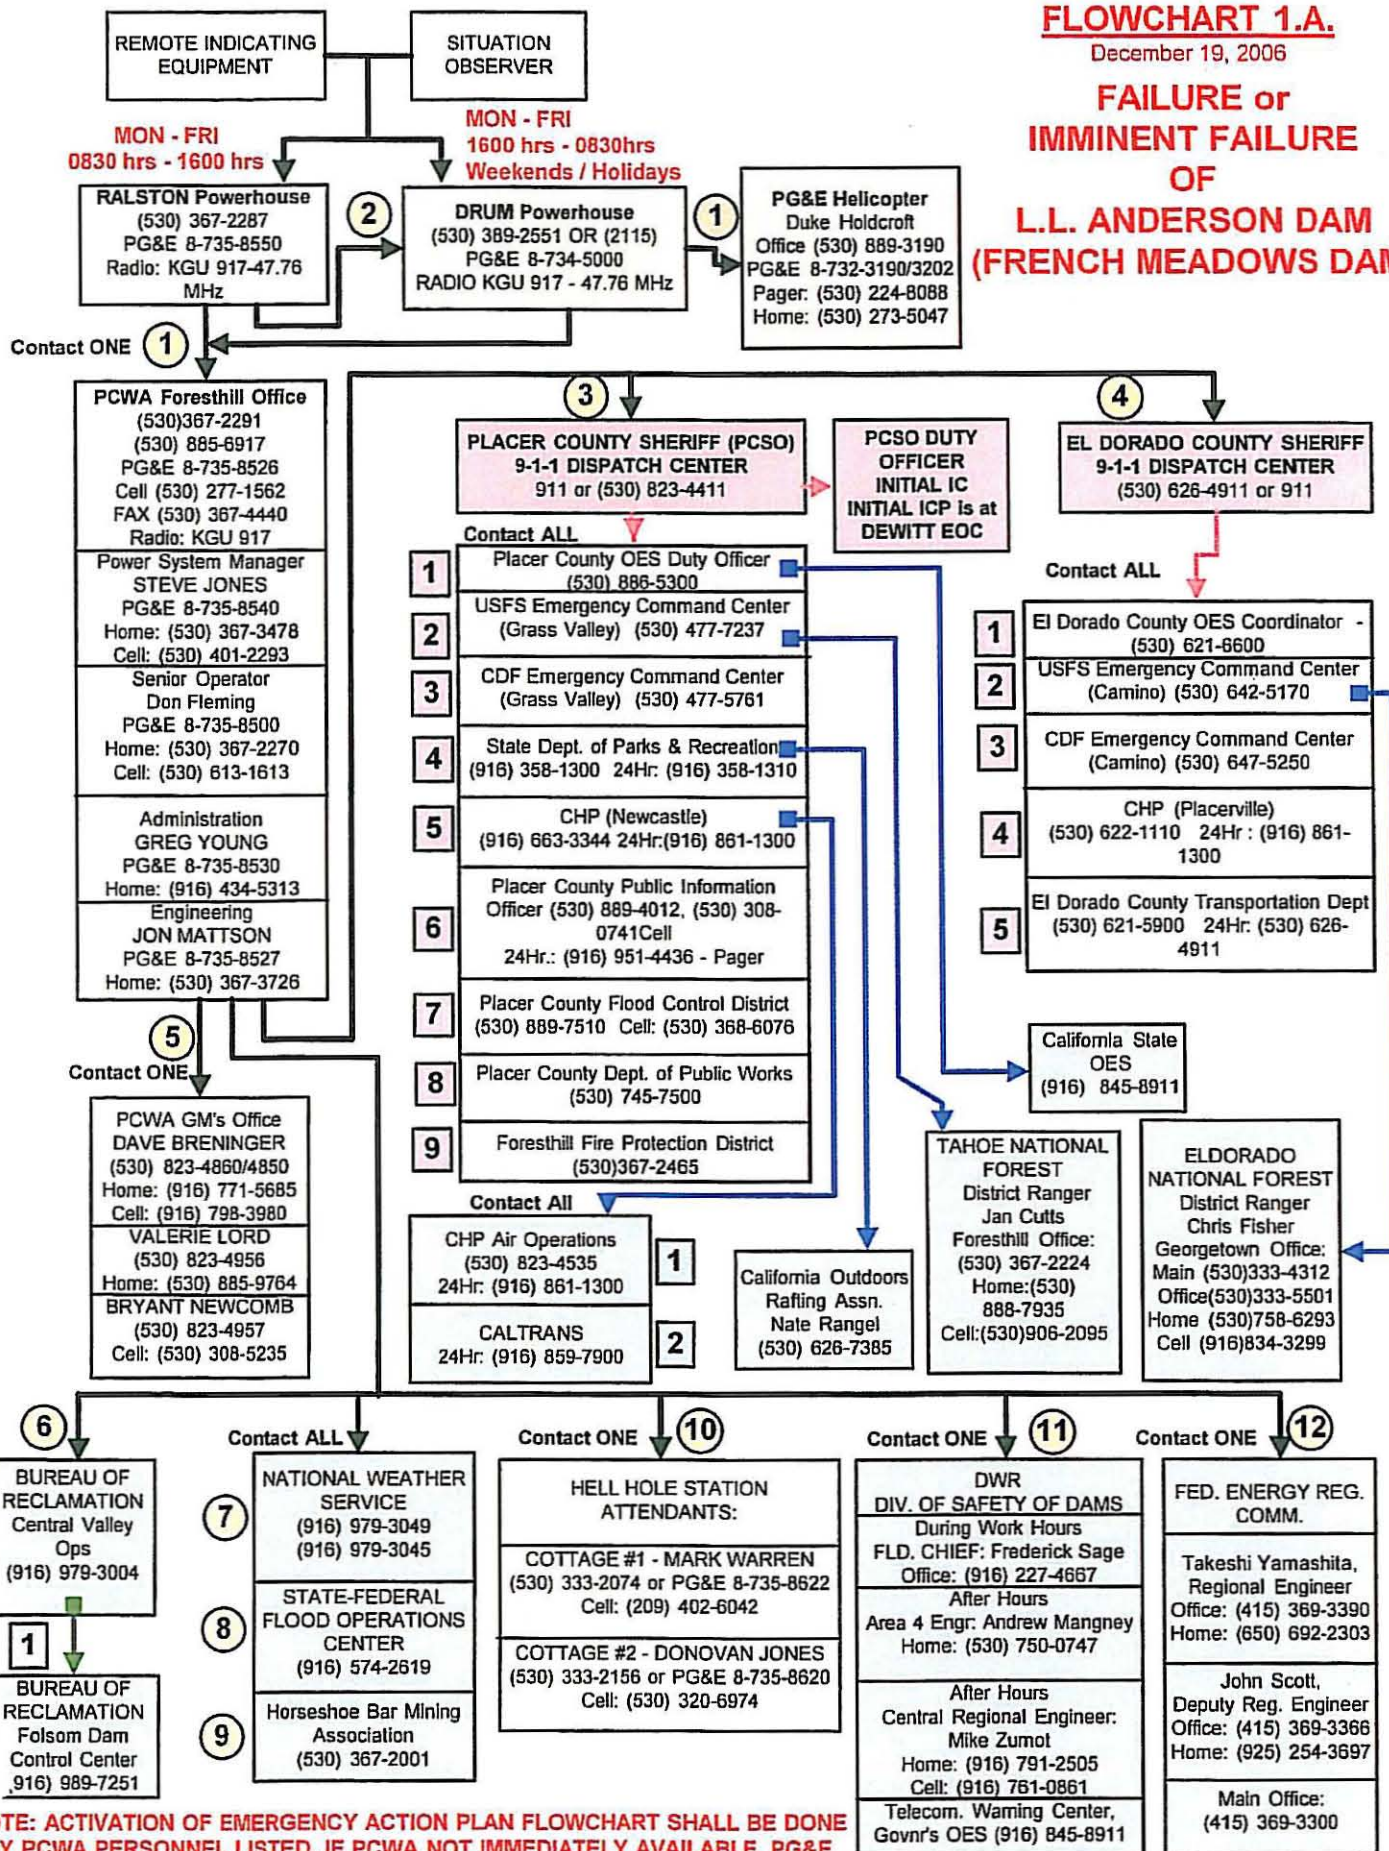


NOTE: ACTIVATION OF EMERGENCY ACTION PLAN FLOWCHART SHALL BE DONE BY PCWA PERSONNEL LISTED. IF PCWA NOT IMMEDIATELY AVAILABLE, PG&E DRUM SHALL ACTIVATE EAP, CALL 911 & IMPLEMENT PCWA CALL TREE.

FLOWCHART 1.B.

December 19, 2006

**POTENTIALLY
HAZARDOUS SITUATION
IS DEVELOPING AT
L.L. ANDERSON DAM
(FRENCH MEADOWS DAM)**

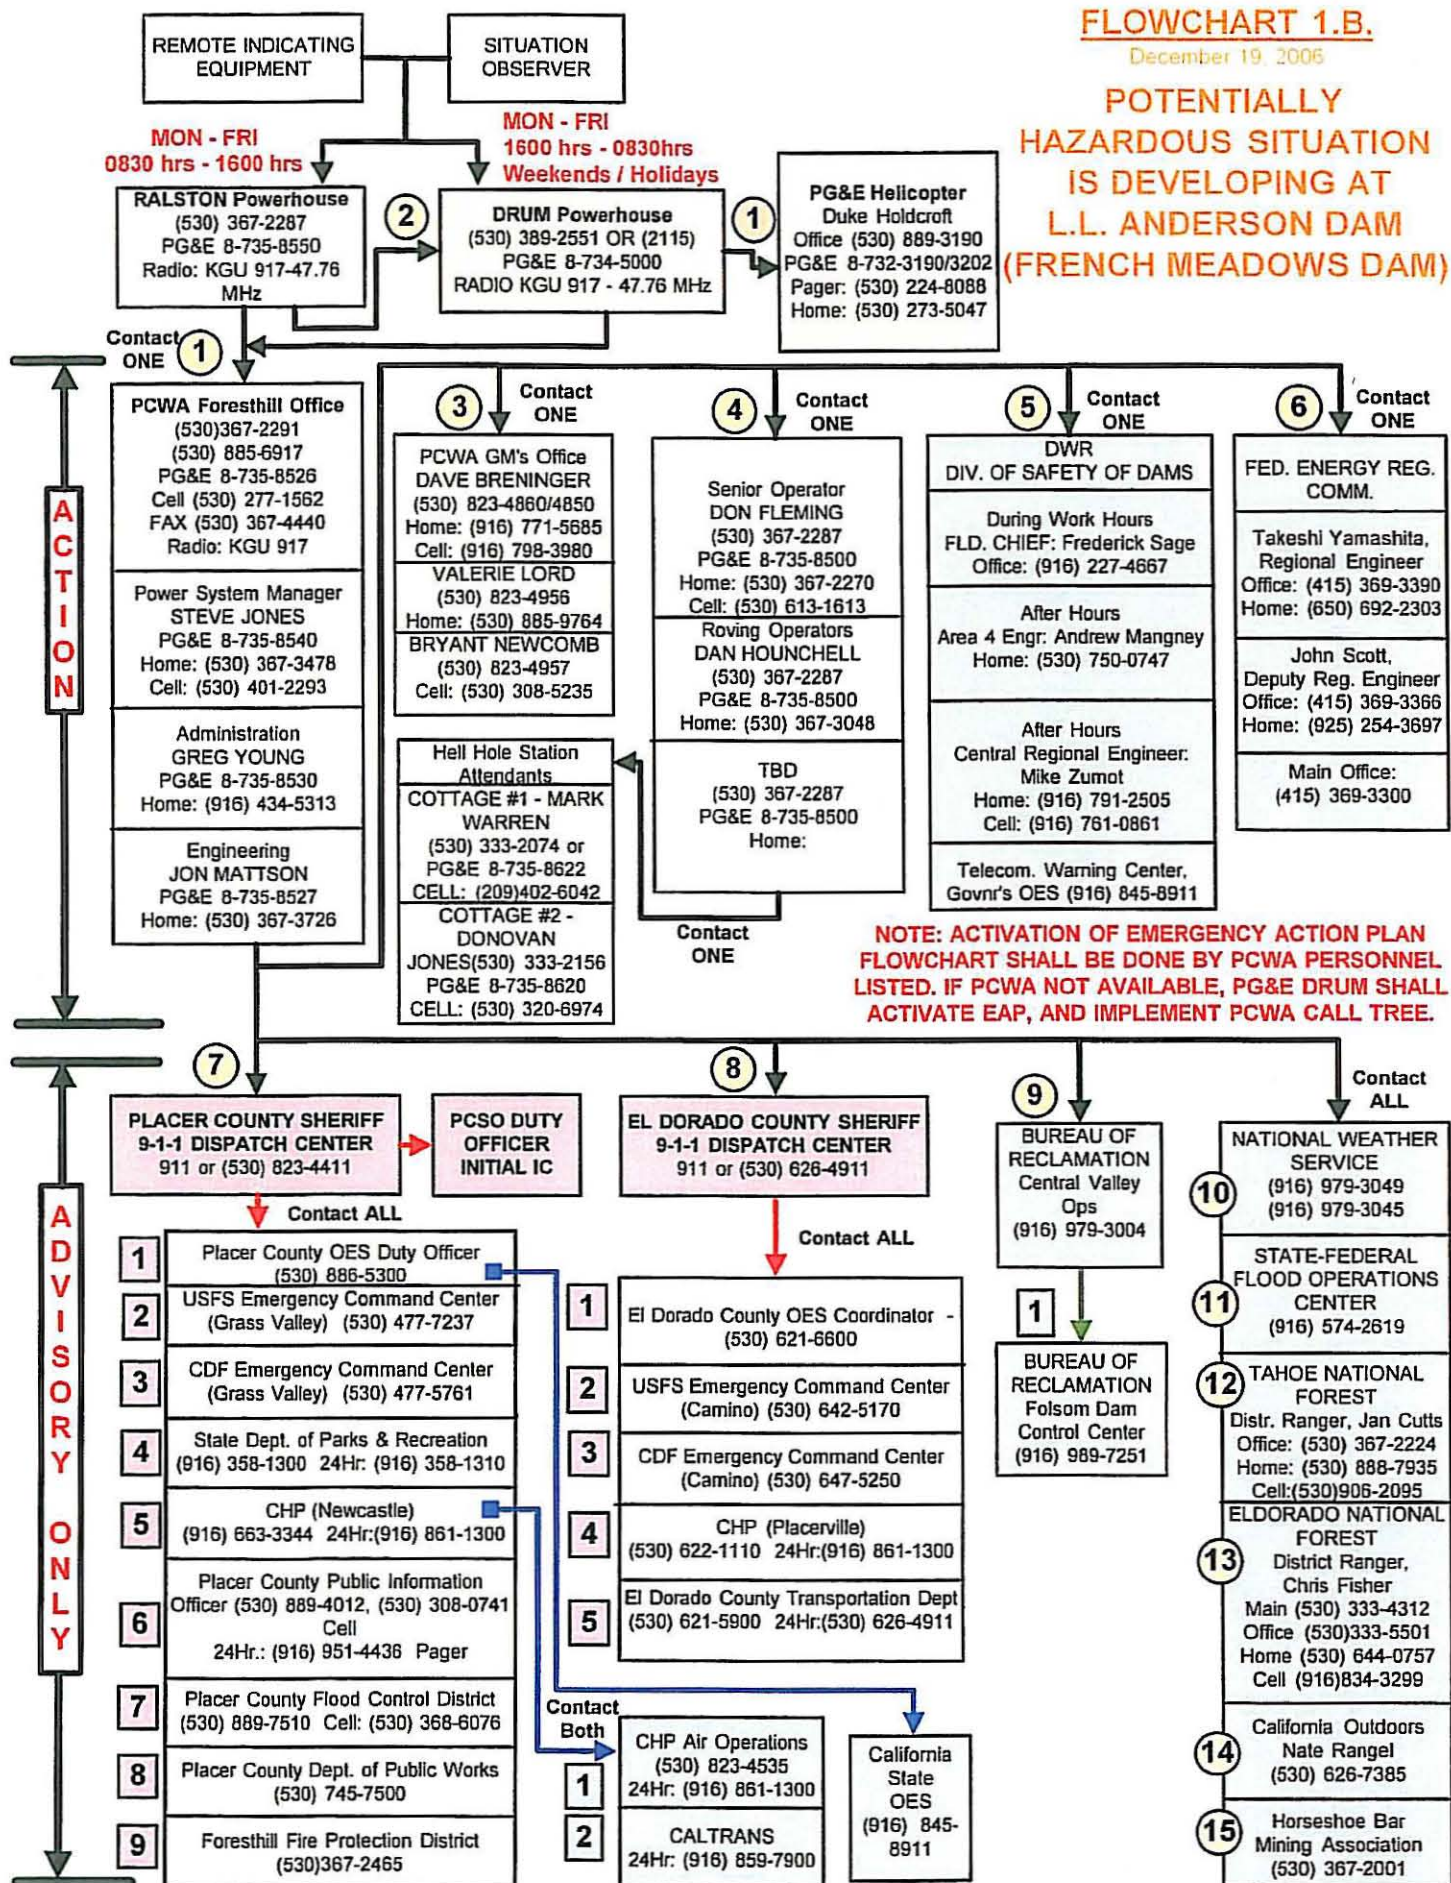


FLOWCHART 1.C.

December 19, 2006

NON-FAILURE EMERGENCY CONDITION AT L.L. ANDERSON DAM (FRENCH MEADOWS DAM)

**PHONE CONTACTS WILL BE MADE
AS NECESSARY DEPENDING ON
THE NATURE OF THE EMERGENCY**

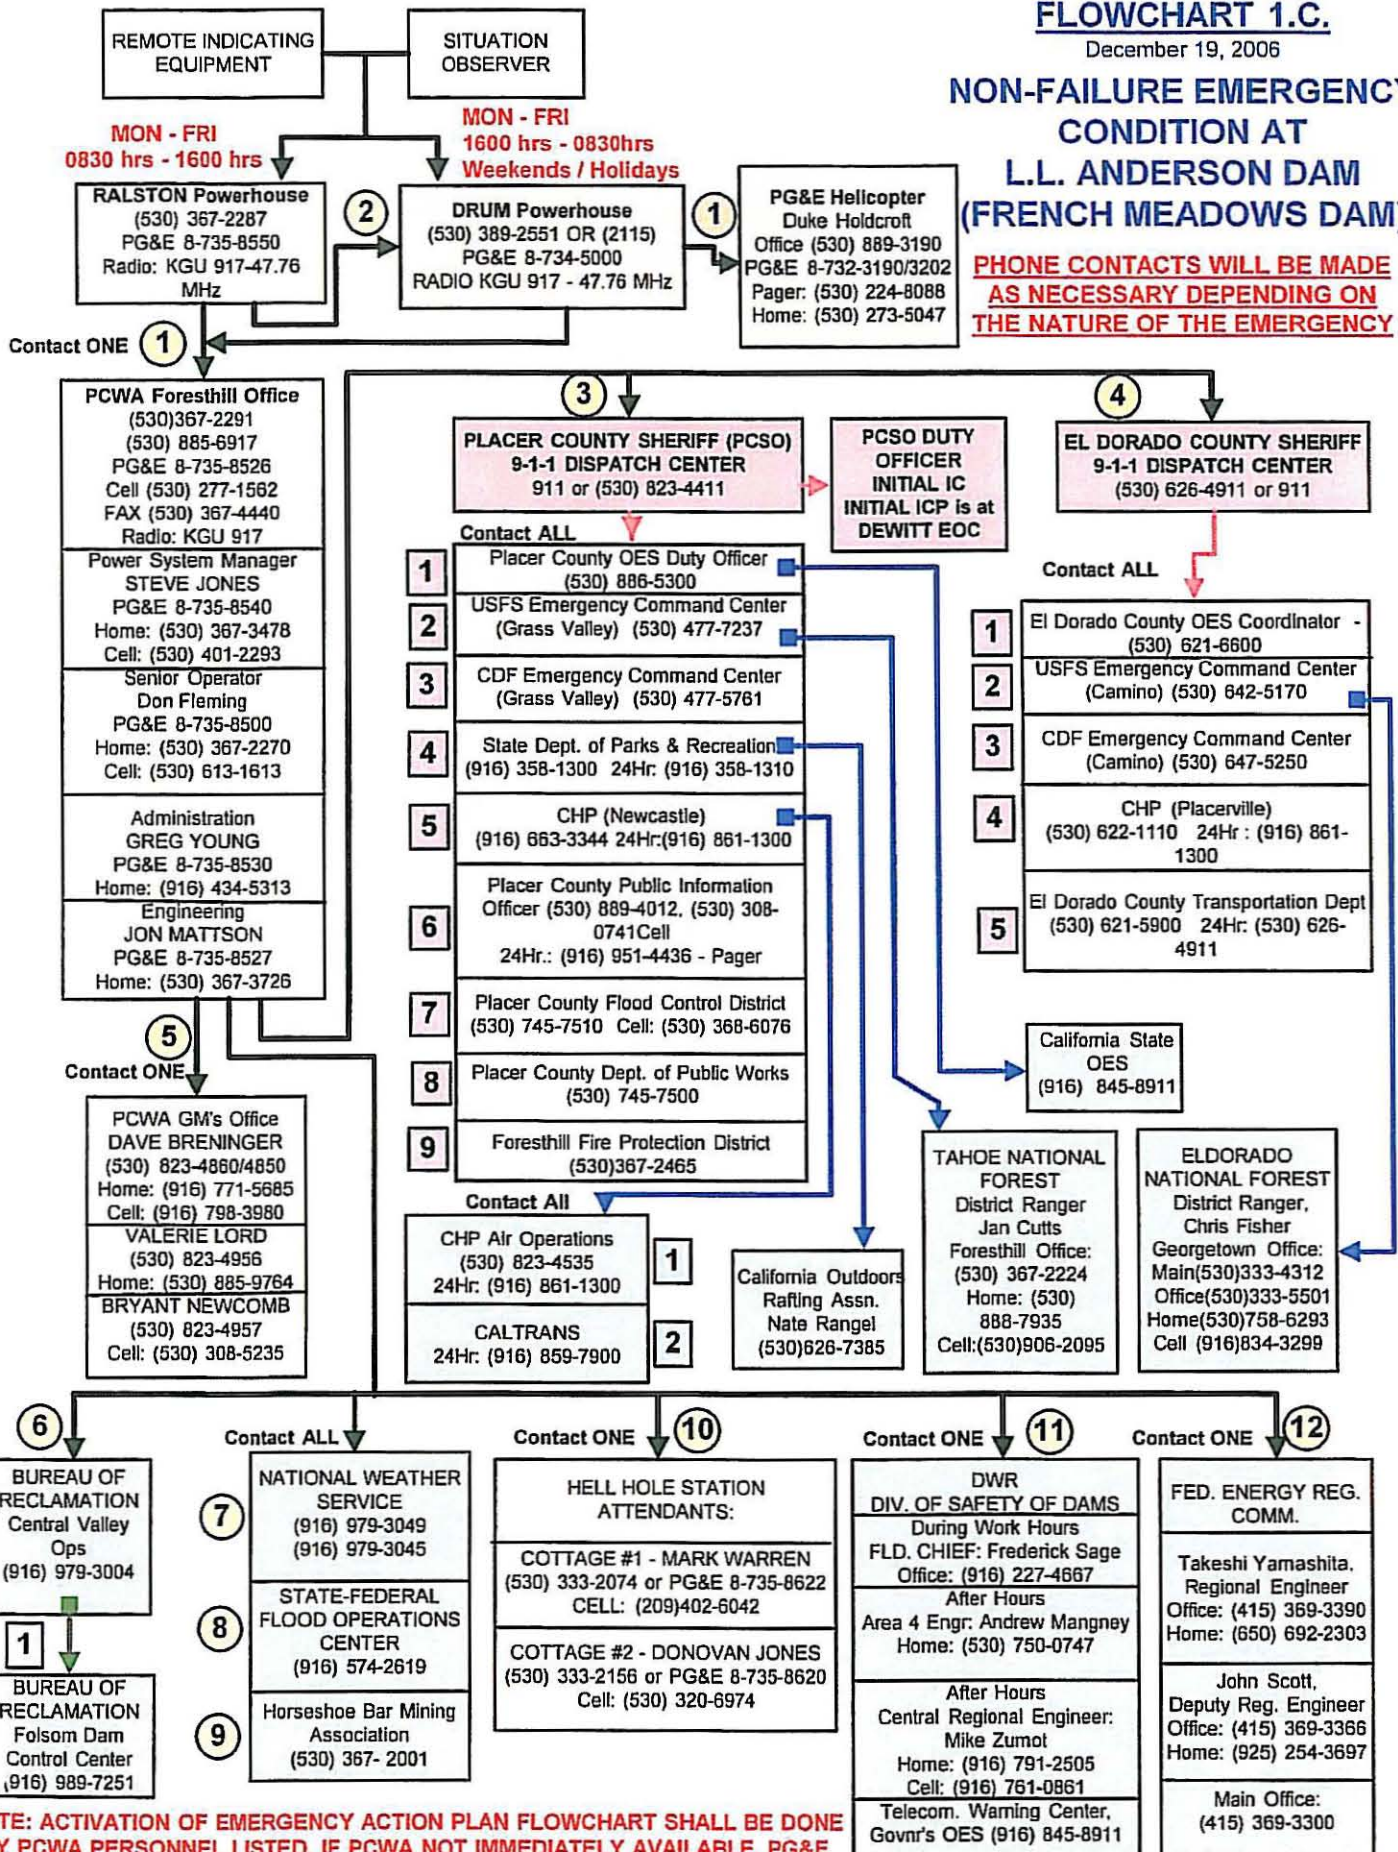


NOTE: ACTIVATION OF EMERGENCY ACTION PLAN FLOWCHART SHALL BE DONE BY PCWA PERSONNEL LISTED. IF PCWA NOT IMMEDIATELY AVAILABLE, PG&E DRUM SHALL ACTIVATE EAP, CALL 911 & IMPLEMENT PCWA CALL TREE.

FLOWCHART 2.A.

December 19, 2006

FAILURE or IMMINENT FAILURE OF HELL HOLE DAM

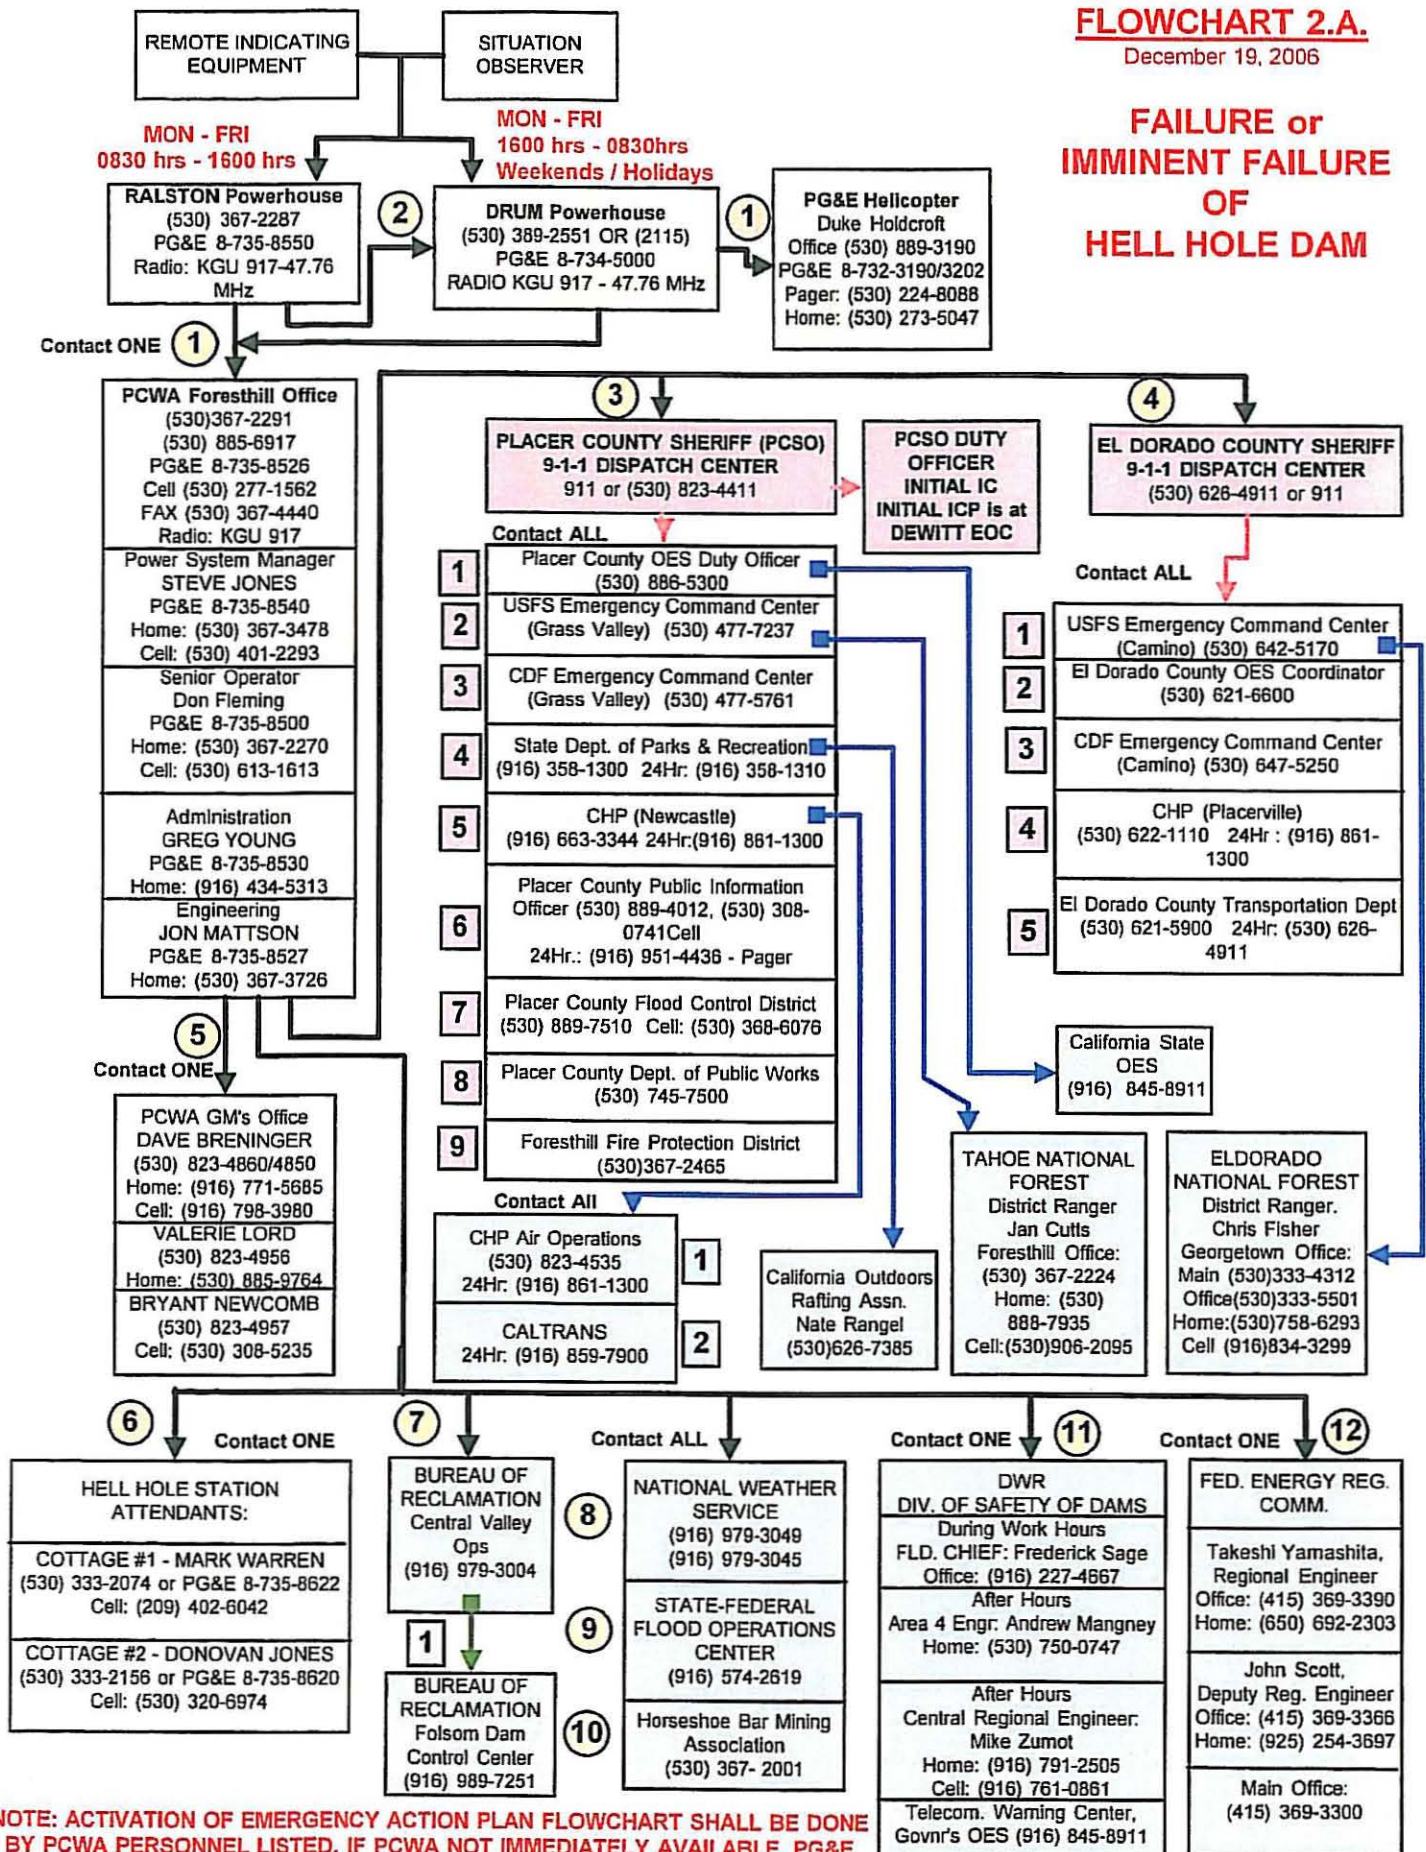


NOTE: ACTIVATION OF EMERGENCY ACTION PLAN FLOWCHART SHALL BE DONE BY PCWA PERSONNEL LISTED. IF PCWA NOT IMMEDIATELY AVAILABLE, PG&E DRUM SHALL ACTIVATE EAP, CALL 911 & IMPLEMENT PCWA CALL TREE.

FLOWCHART 2.B.

December 19 2006

**POTENTIALLY
HAZARDOUS SITUATION
IS DEVELOPING AT
HELL HOLE DAM**

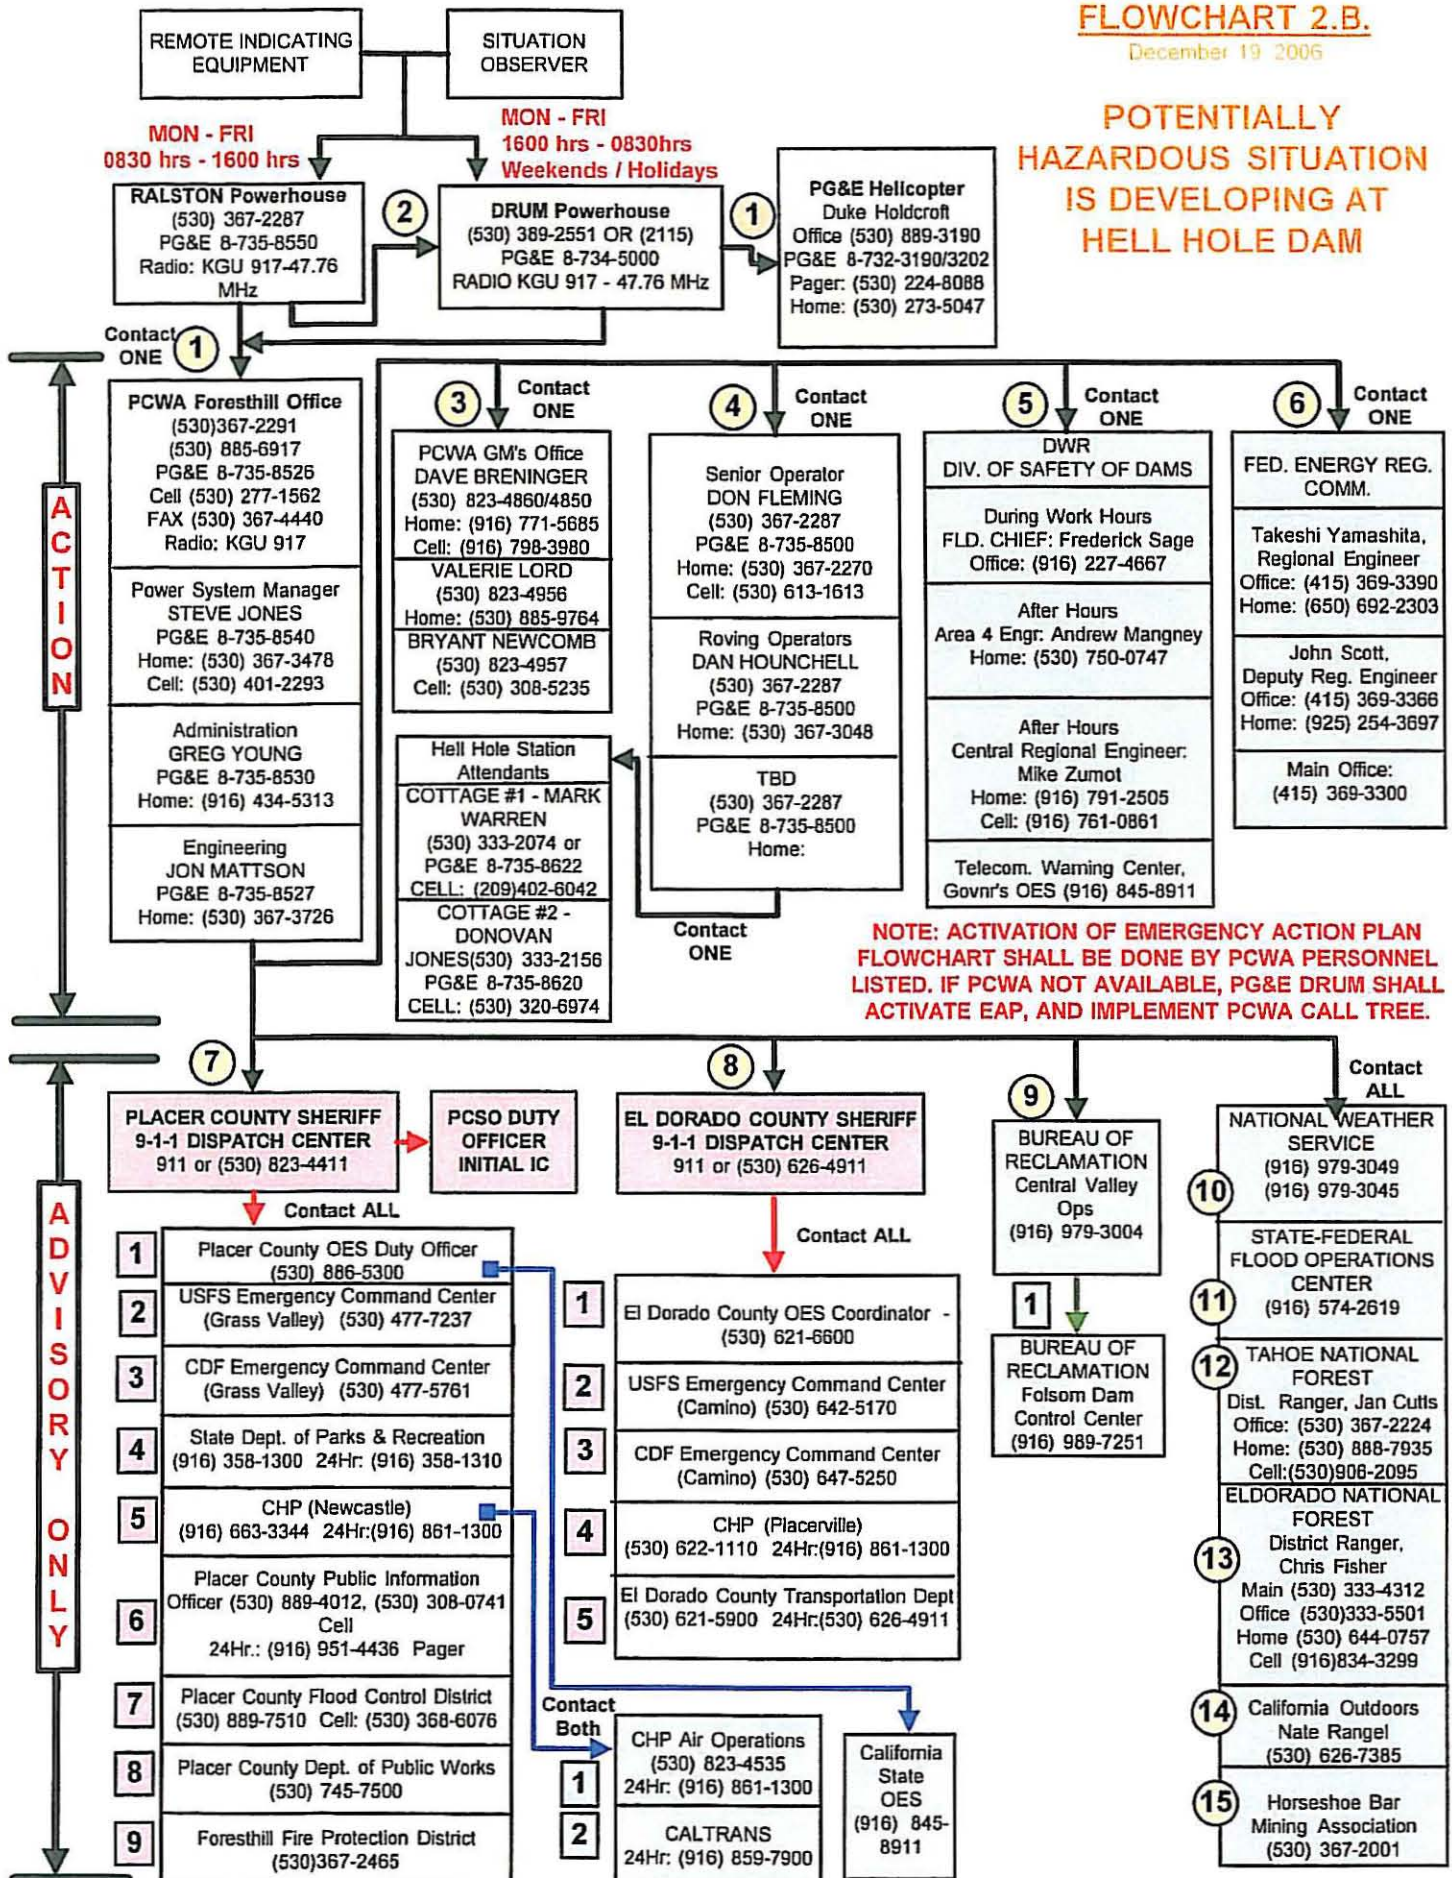


FLOWCHART 2.C.

December 19, 2006

NON-FAILURE EMERGENCY CONDITION AT HELL HOLE DAM

**PHONE CONTACTS WILL BE MADE
AS NECESSARY DEPENDING ON
THE NATURE OF THE EMERGENCY**

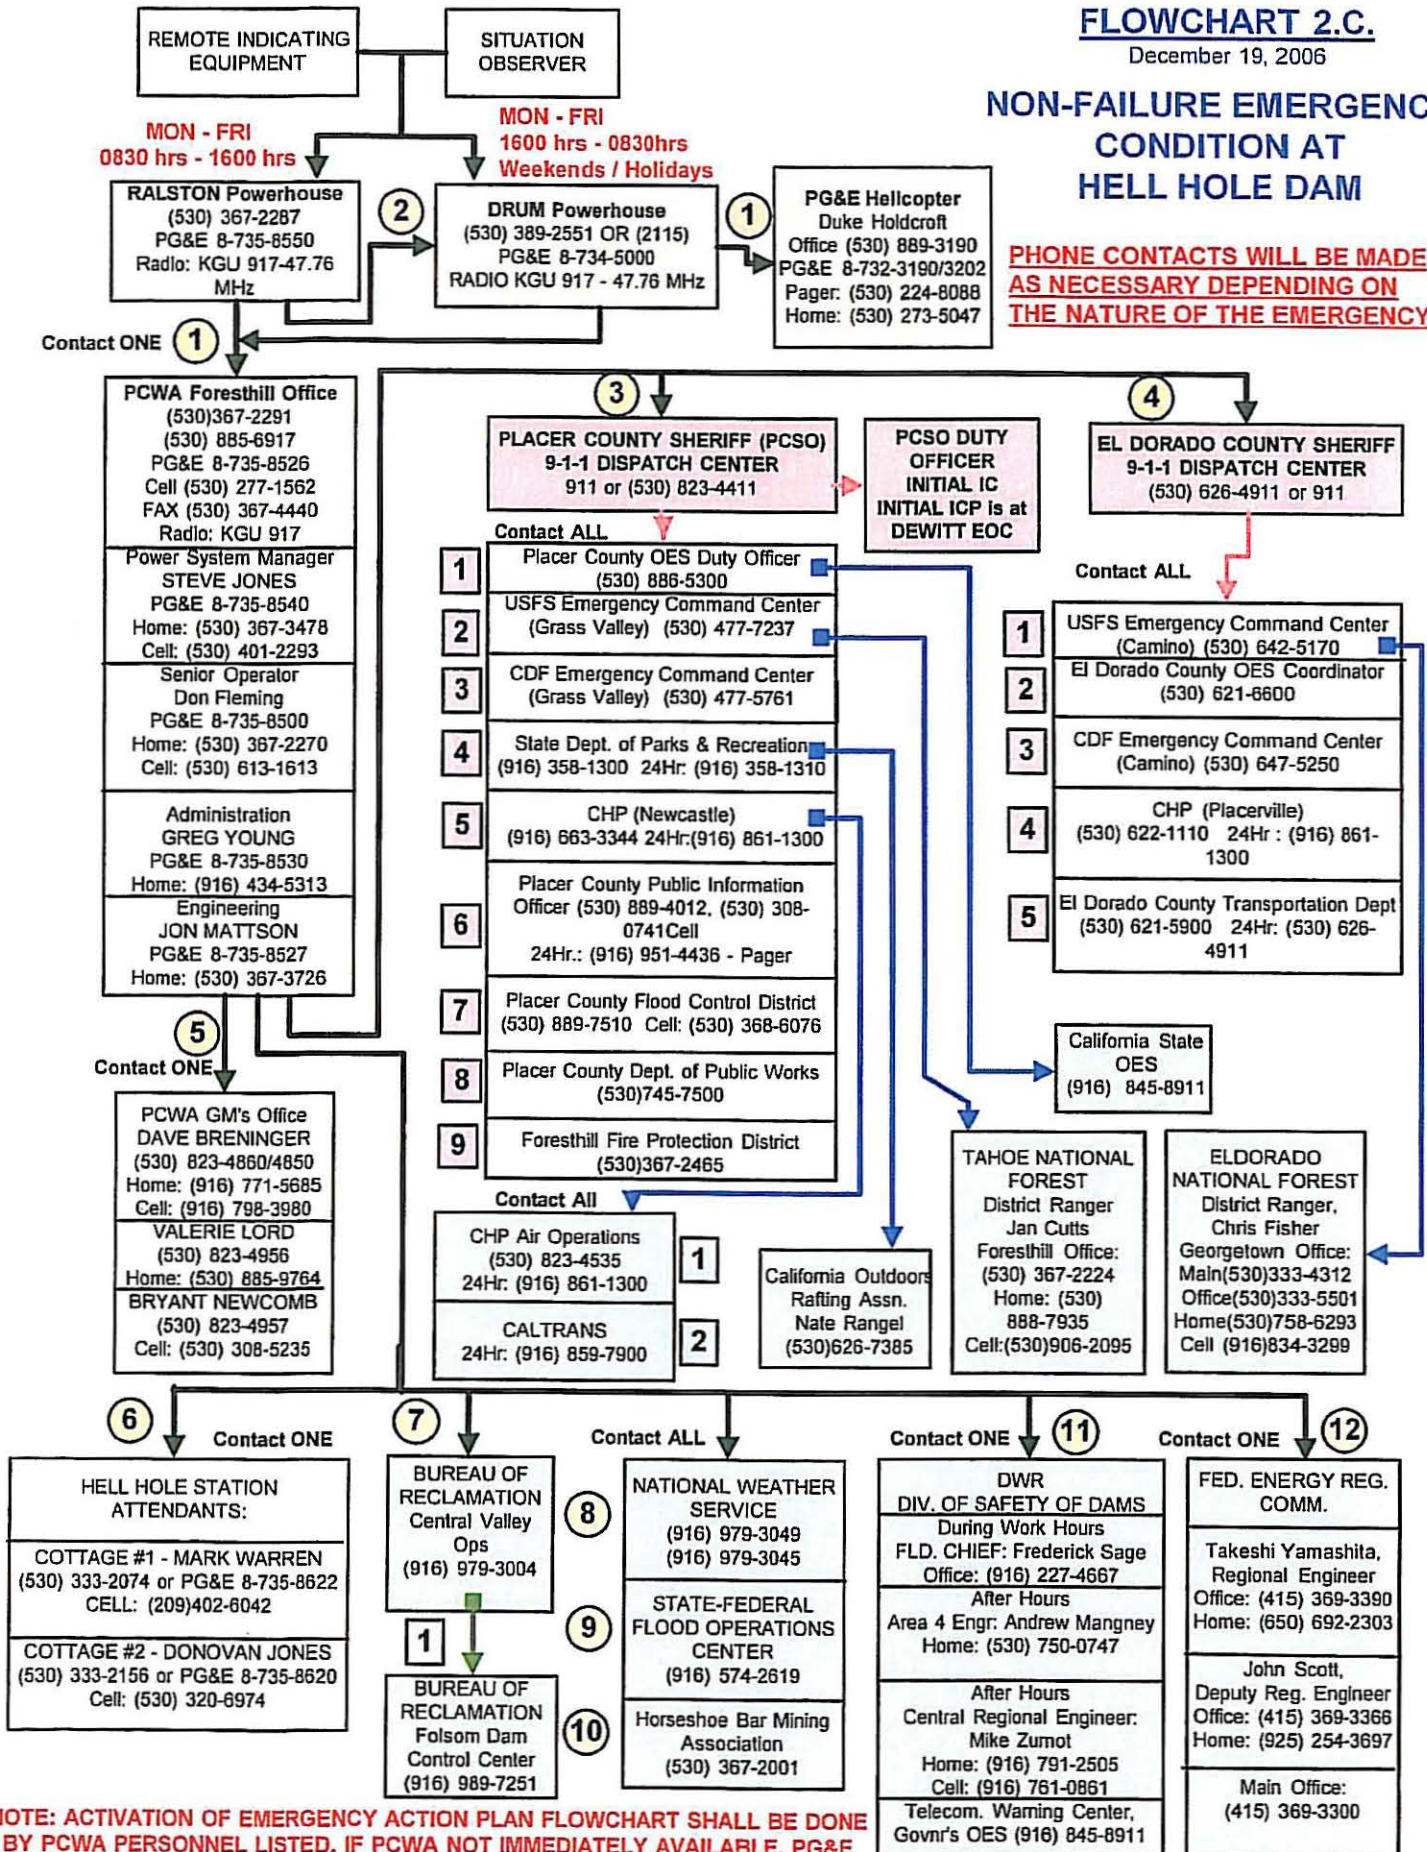


NOTE: ACTIVATION OF EMERGENCY ACTION PLAN FLOWCHART SHALL BE DONE BY PCWA PERSONNEL LISTED. IF PCWA NOT IMMEDIATELY AVAILABLE, PG&E DRUM SHALL ACTIVATE EAP, CALL 911 & IMPLEMENT PCWA CALL TREE.

FLOWCHART 3.A.

December 19, 2006

FAILURE or IMMINENT FAILURE OF RALSTON AFTERBAY DAM

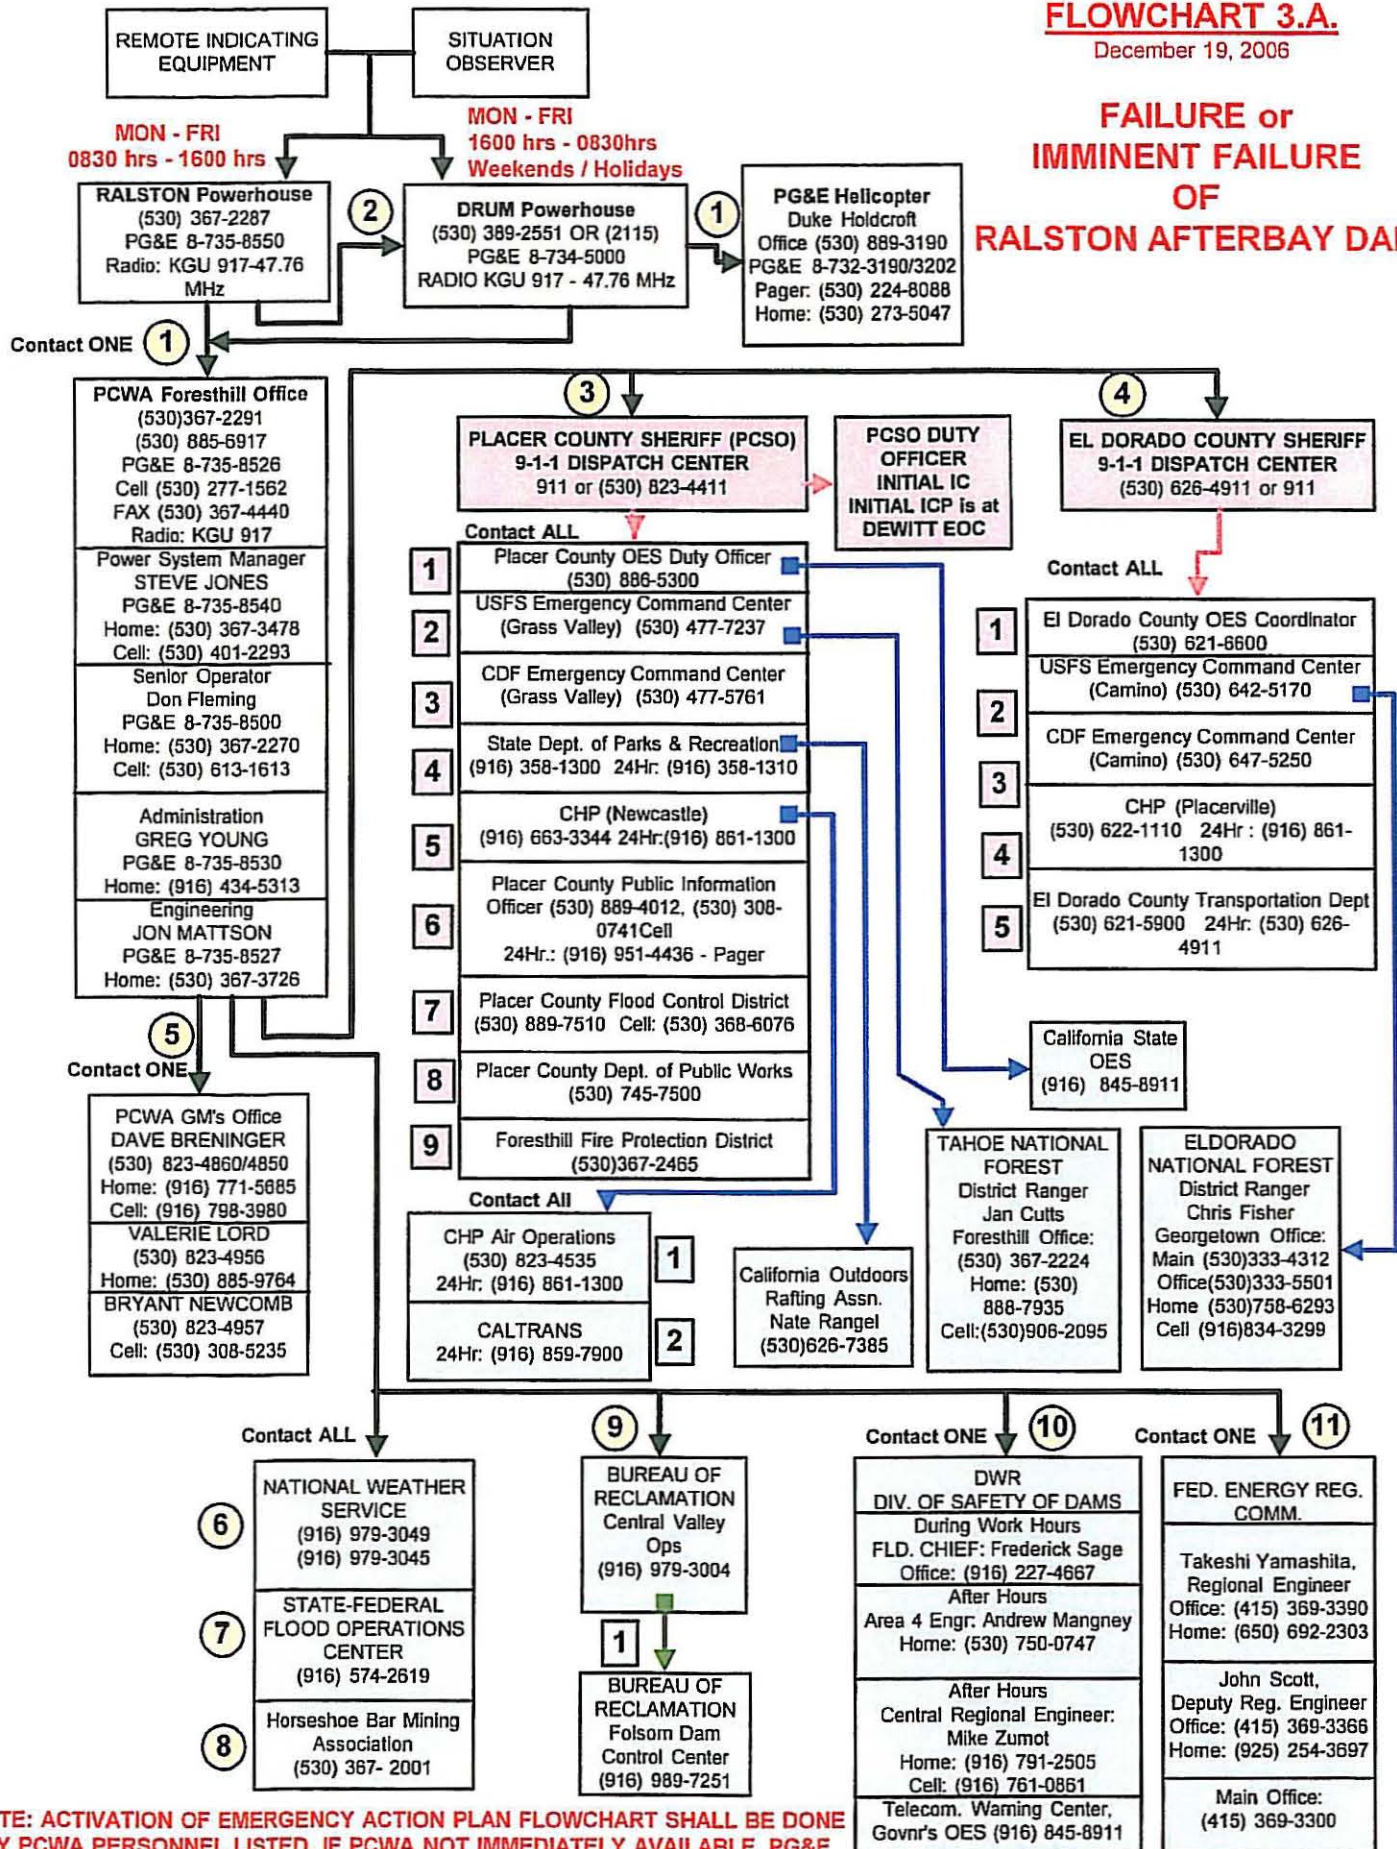


NOTE: ACTIVATION OF EMERGENCY ACTION PLAN FLOWCHART SHALL BE DONE BY PCWA PERSONNEL LISTED. IF PCWA NOT IMMEDIATELY AVAILABLE, PG&E DRUM SHALL ACTIVATE EAP, CALL 911 & IMPLEMENT PCWA CALL TREE.

FLOWCHART 3.B.

December 19, 2006

**POTENTIALLY
HAZARDOUS SITUATION
IS DEVELOPING AT
RALSTON AFTERBAY
DAM (OXBOW DAM)**

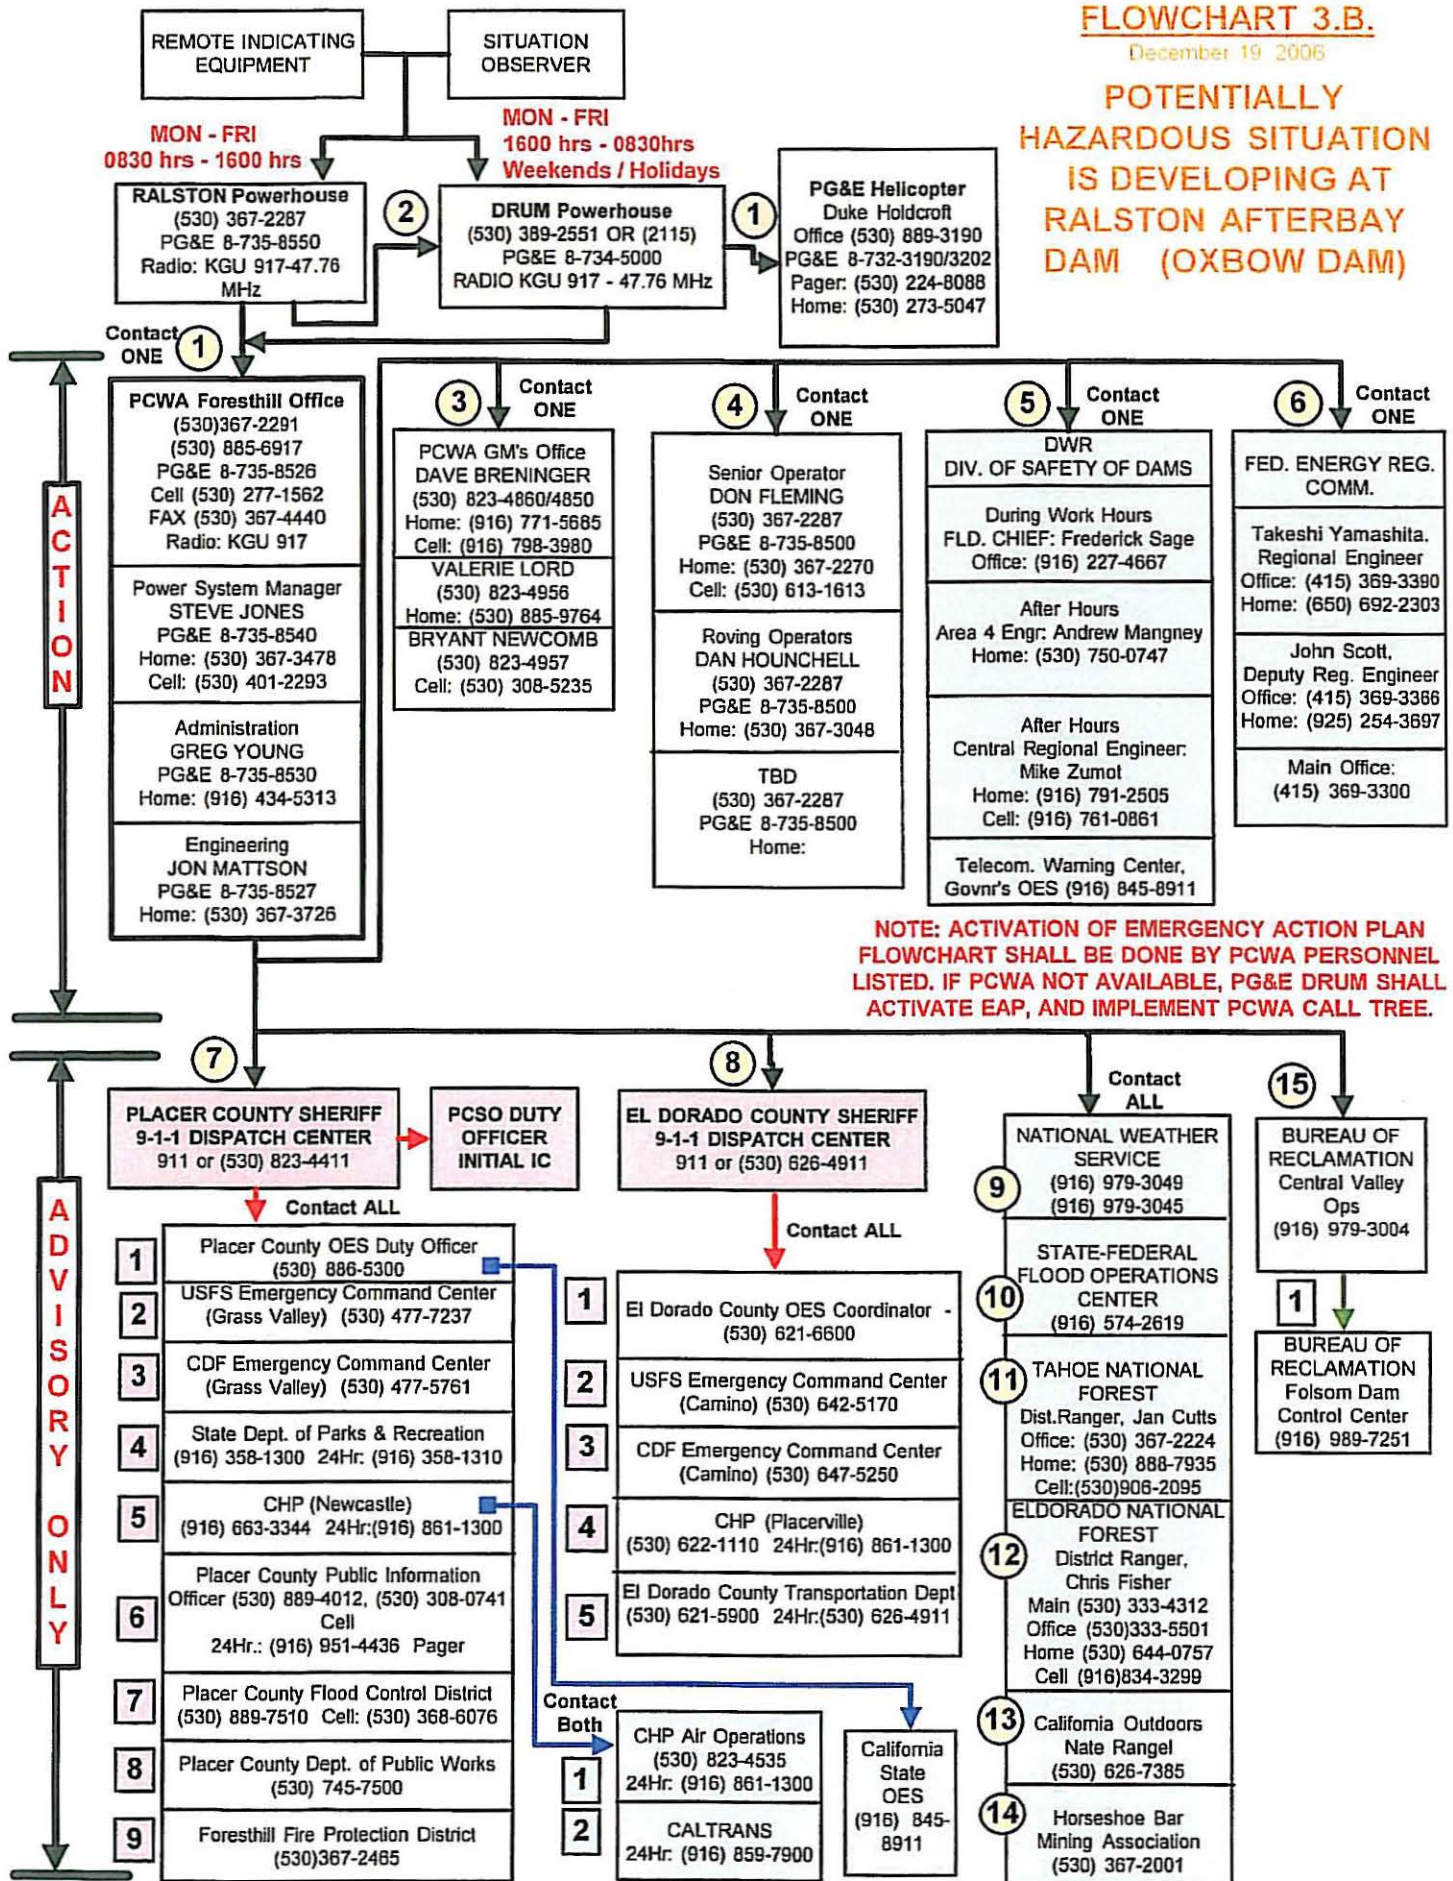


FLOWCHART 3.C.

December 19, 2006

NON-FAILURE EMERGENCY CONDITION AT RALSTON AFTERBAY DAM (OXBOW DAM)

**PHONE CONTACTS WILL BE MADE
AS NECESSARY DEPENDING ON THE
NATURE OF THE EMERGENCY**

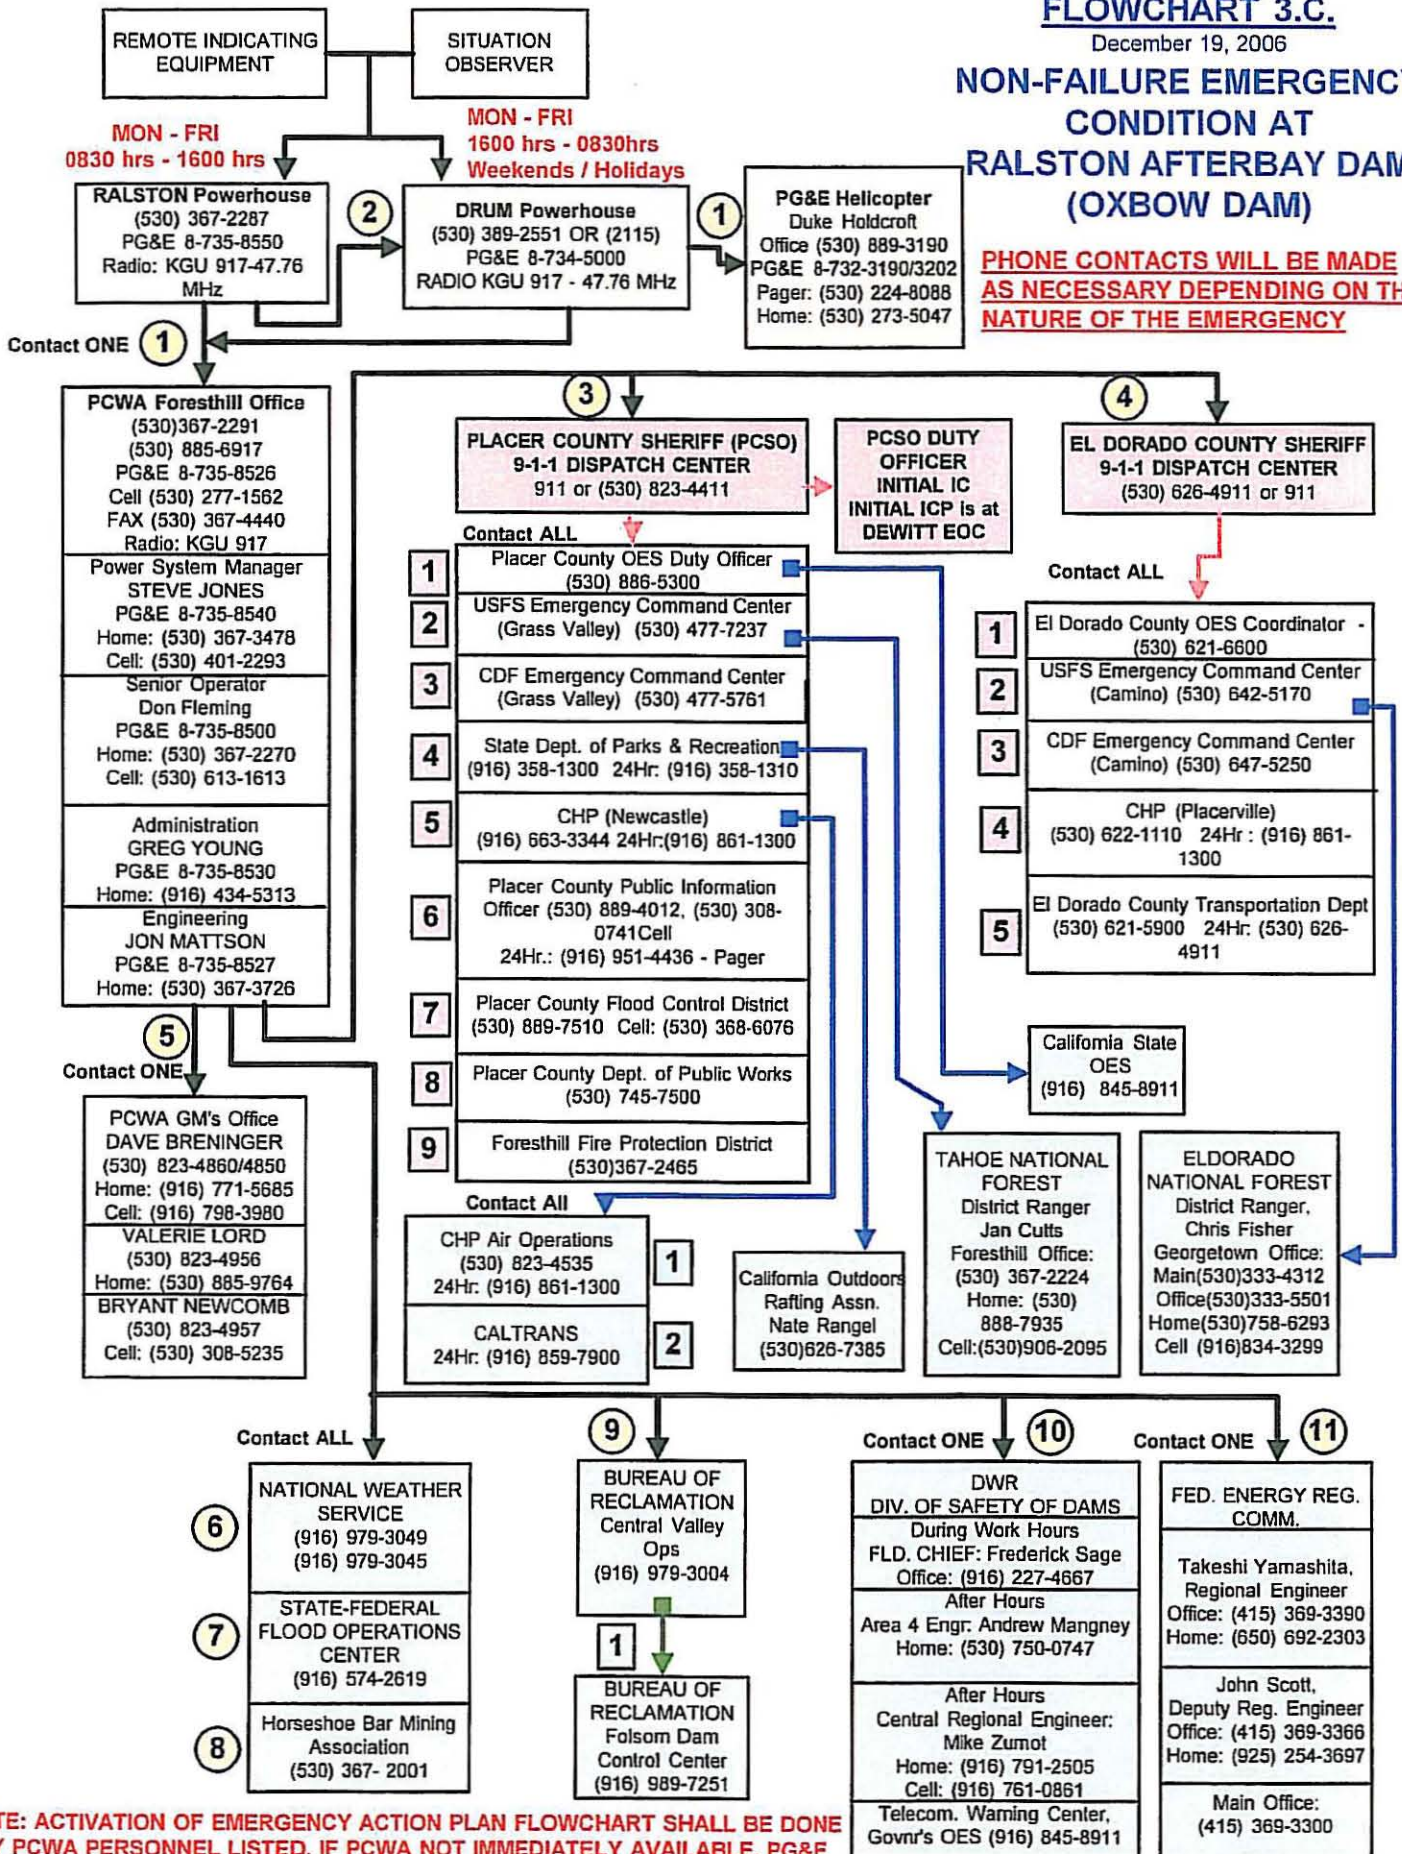

NOTE: ACTIVATION OF EMERGENCY ACTION PLAN FLOWCHART SHALL BE DONE BY PCWA PERSONNEL LISTED. IF PCWA NOT IMMEDIATELY AVAILABLE, PG&E DRUM SHALL ACTIVATE EAP, CALL 911 & IMPLEMENT PCWA CALL TREE.